

Workshop of Public Response to Alerts and Warnings on Mobile Devices: Current Knowledge and Research Needs


david waldrop
david.waldrop@microsoft.com
301.526.9500





only by
working together





can we
cultivate
**healthy
communities**


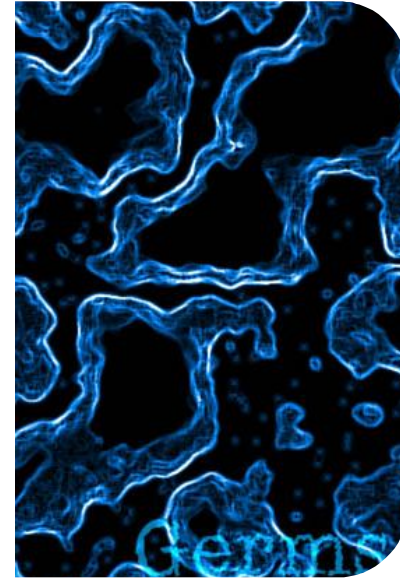


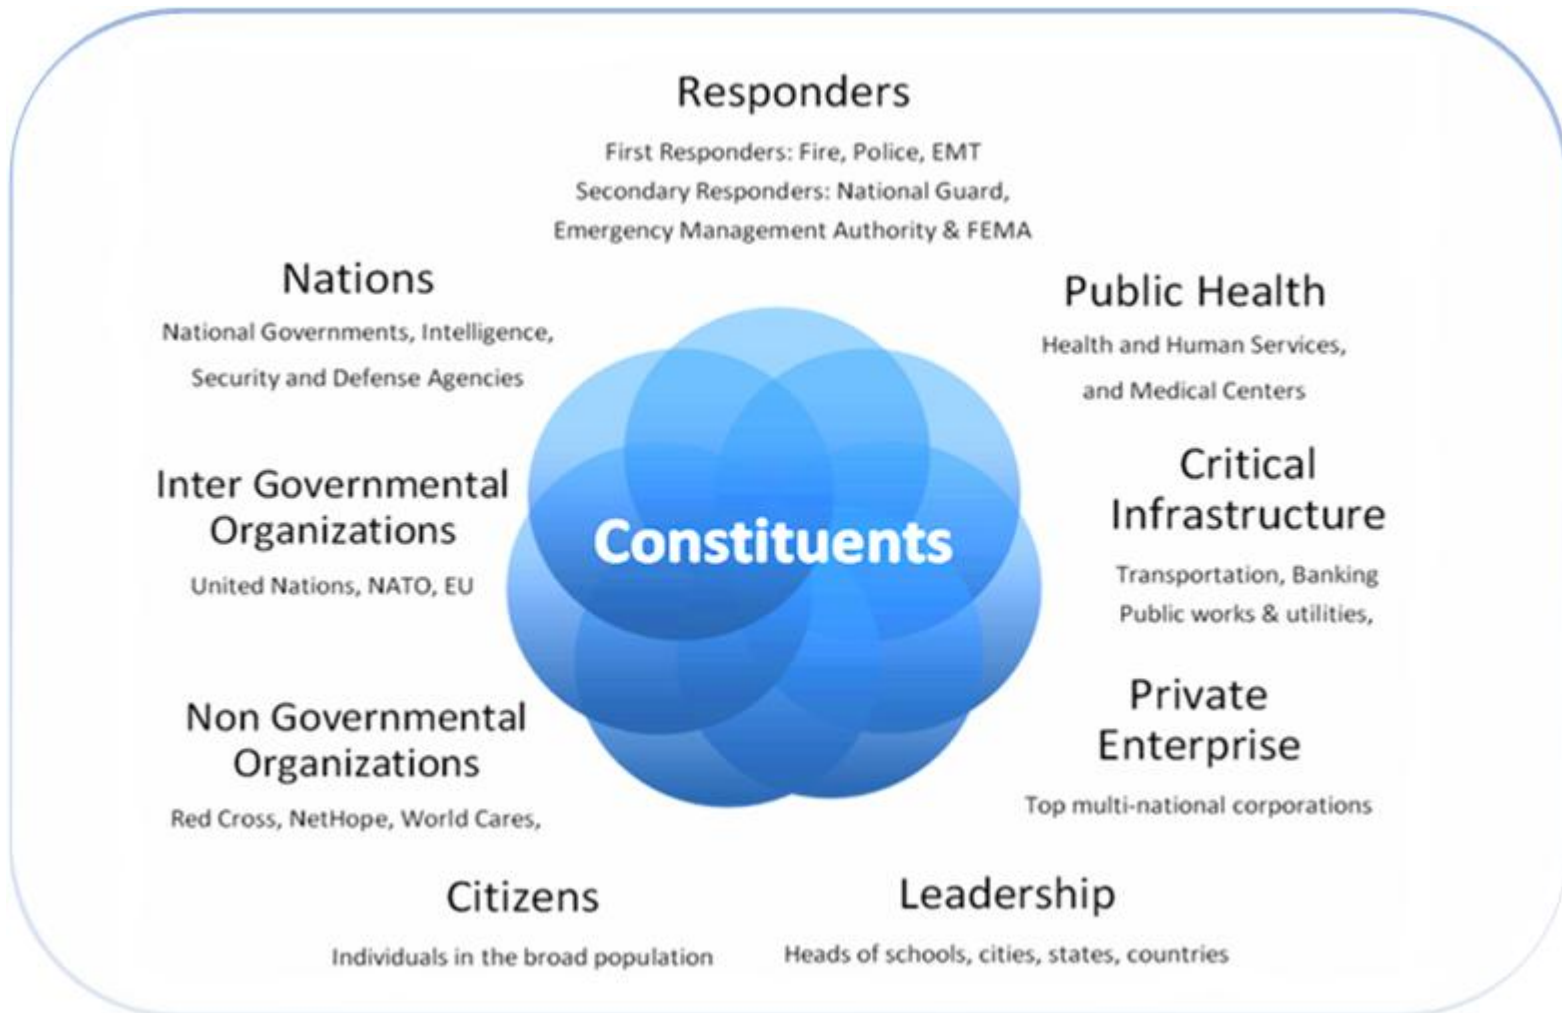

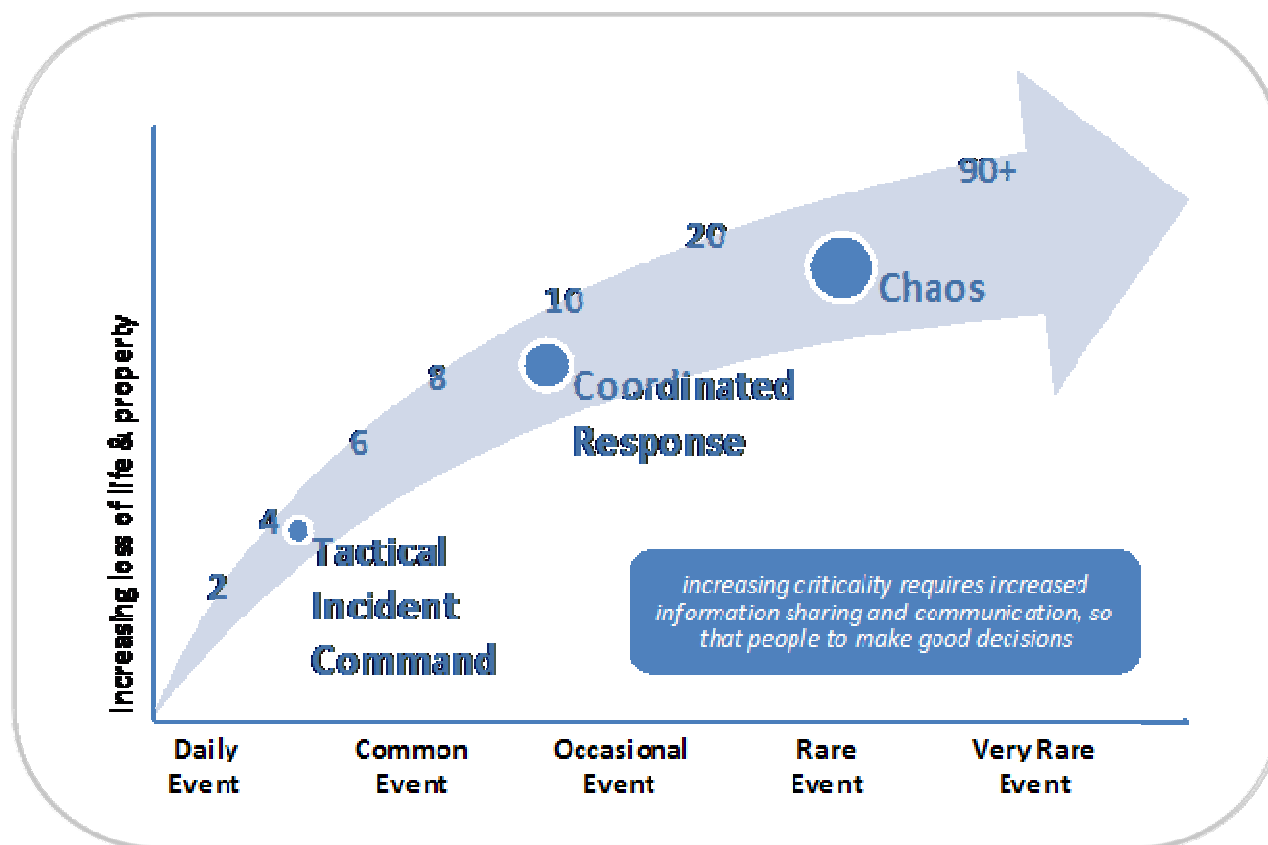

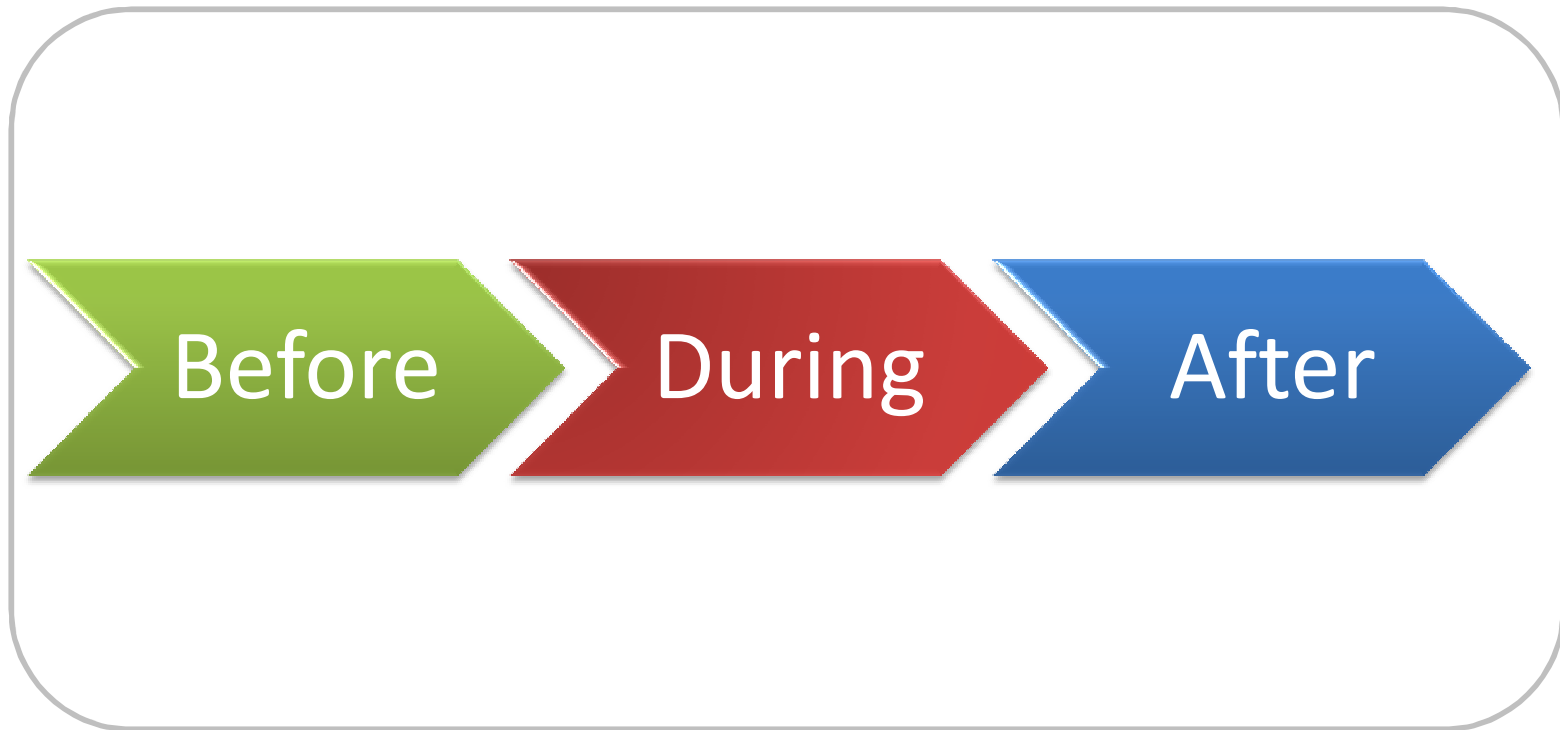

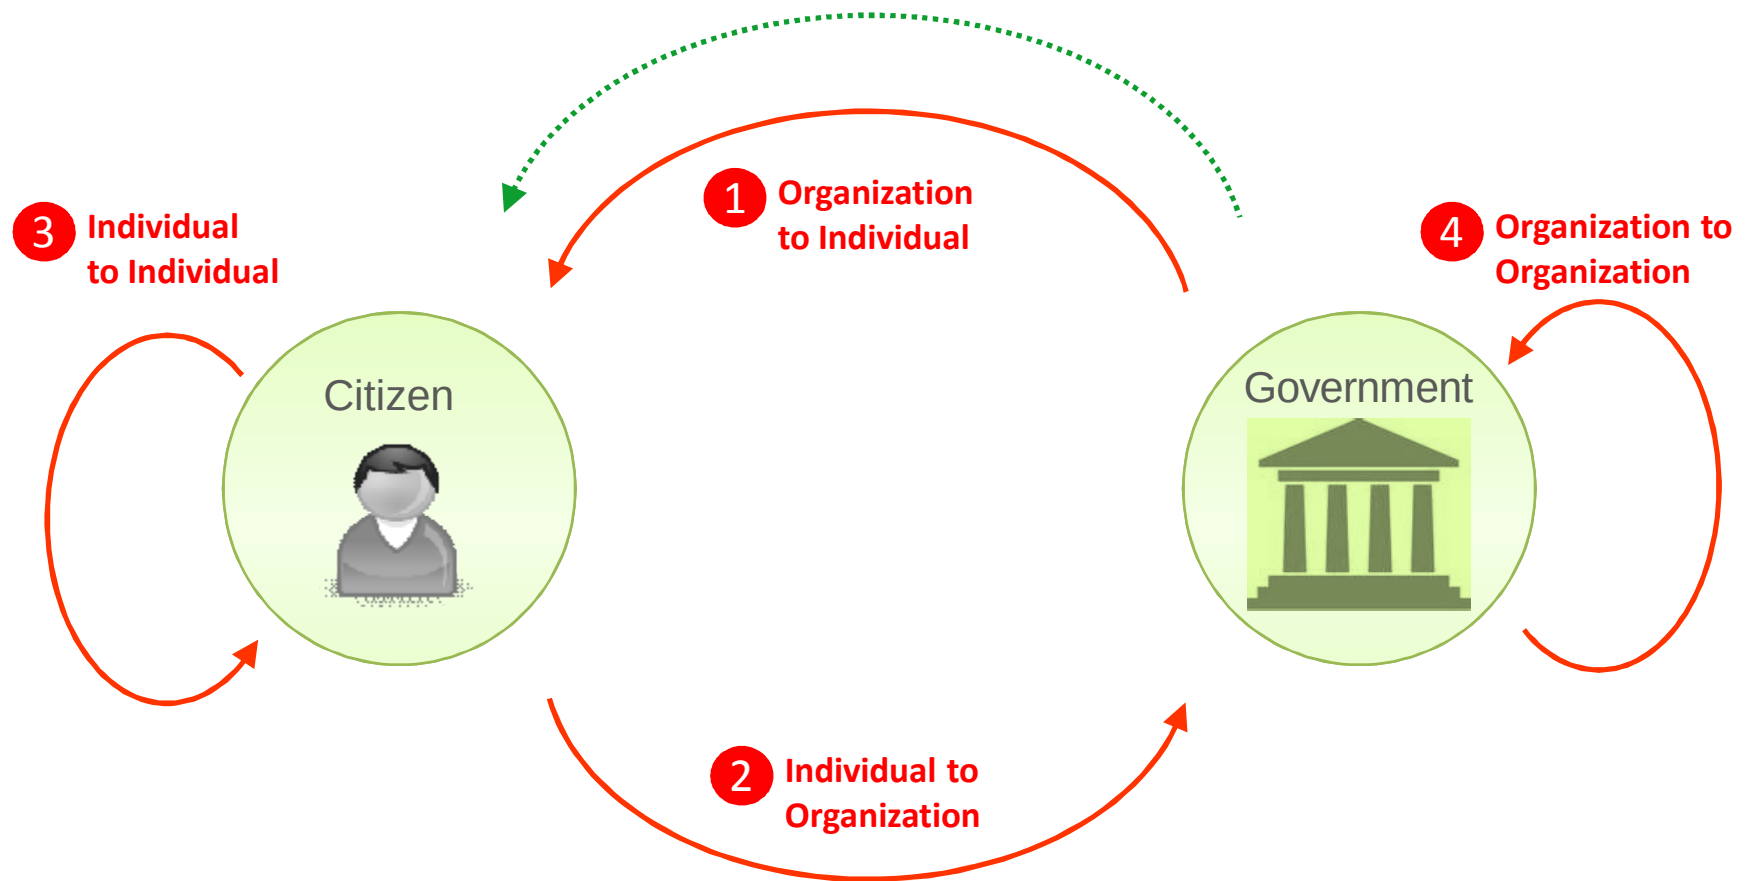

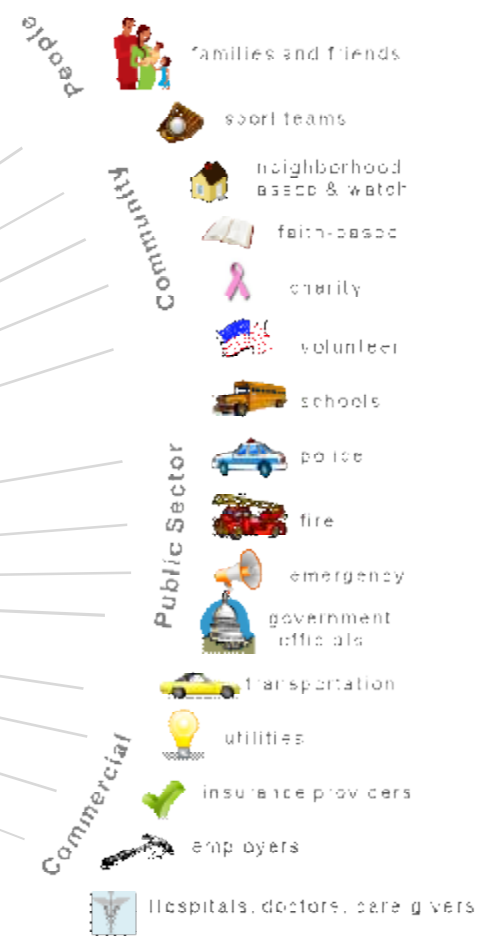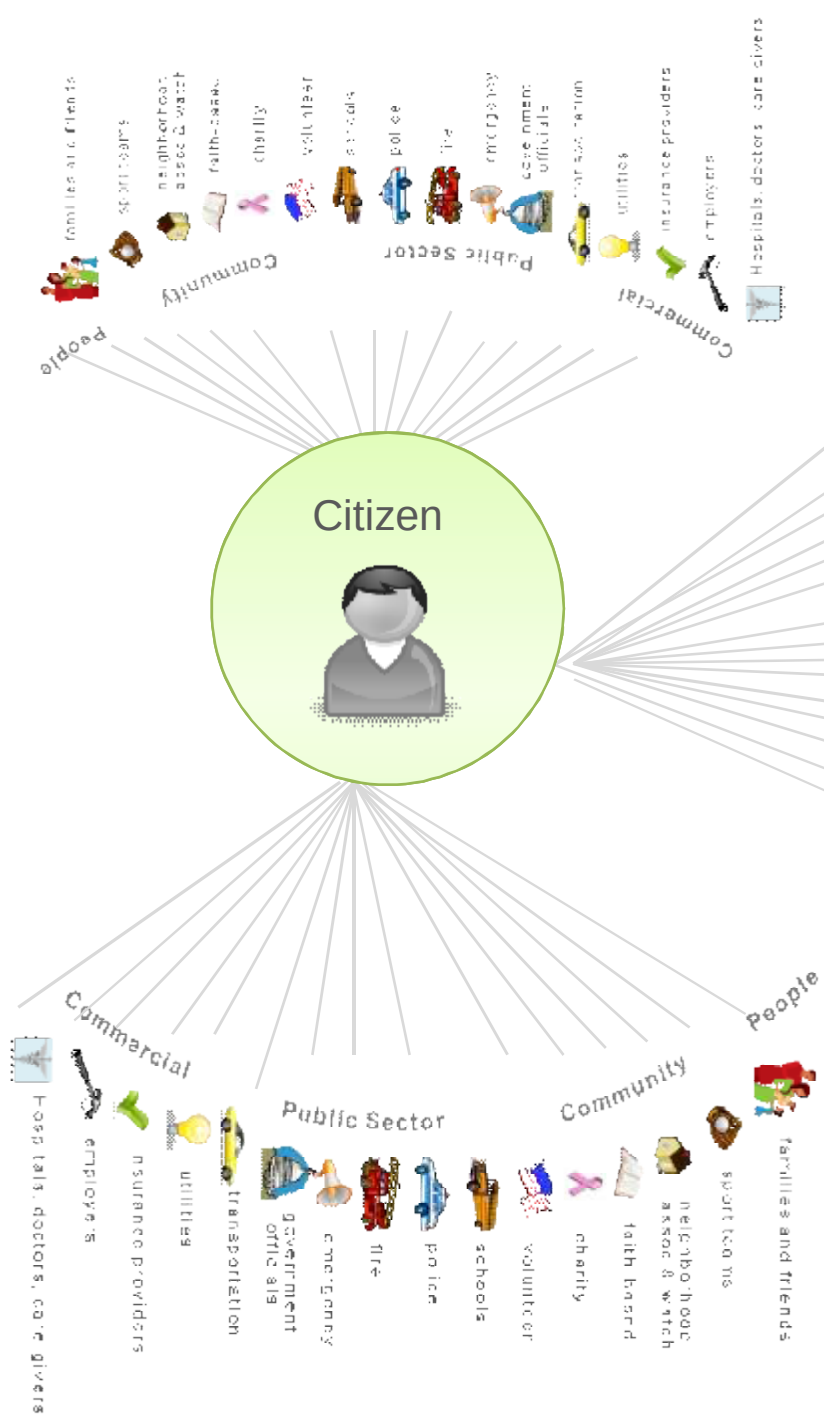

Expressing

Publication					Discussion			
Blog	Wiki	Microblog	News	Livecast	Forum	IM	Comment	3D

Aggregation

socialthing! PLURK

Networking

Search	Niche	BtoB	Mobile	Tools

Social Platforms

Content

Video	Photo	Music	Links

Product

Recommend	Suggestions	Share

Place

Addresses	Events	Trip

Sharing

Social Games

Casual Games


Casual MMO

MOG


MMORPG

Gaming

Trust in Government

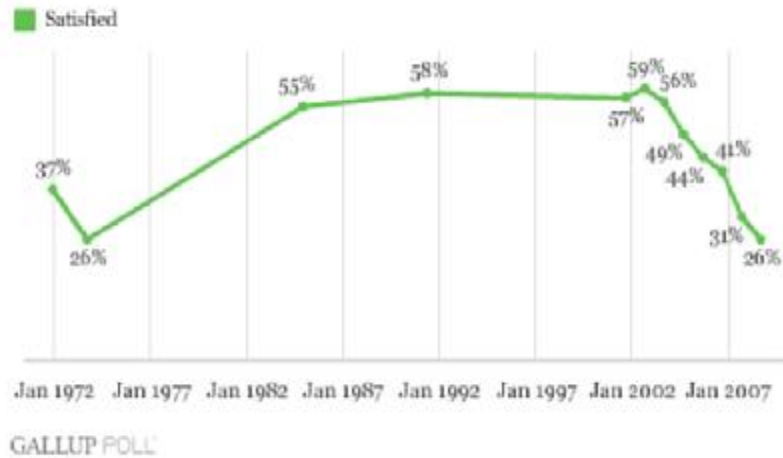

Voter Turnout

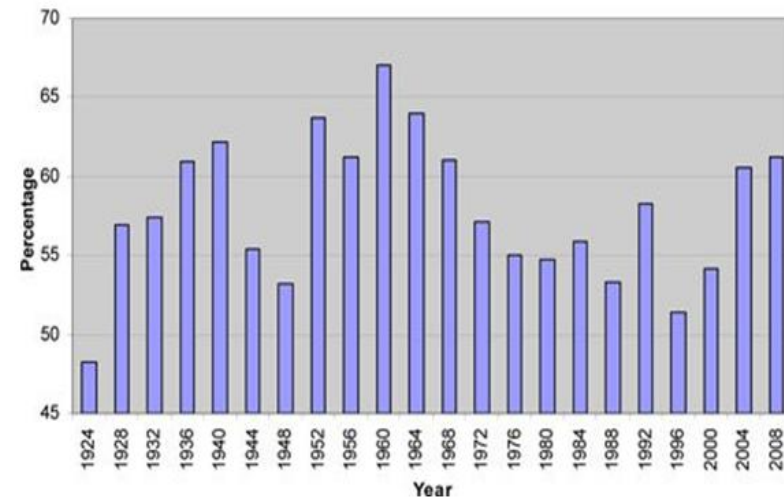

Government Agency Web Sites



Public Safety Notification

District of Houston
 P.O. BOX 370
 HOUSTON, BRITISH COLUMBIA V0J 1Z0
 TELEPHONE: (250) 845-2238
 FAX: (250) 845-3429
 E-MAIL: doth@mail.bulley.net

April 30, 2002

NEWS RELEASE

WATER RESTRICTIONS

The District of Houston has currently ceased operation of the two wells that have received elevated bacterial levels in sampling results. All users of the municipal water system must conserve water as the District of Houston is currently able to use only ONE of its three water wells.

On the afternoon of April 25, 2002 the District of Houston received preliminary water test results that showed elevated bacterial levels in two of the three District's water wells. The two shallow wells are located near Buck Creek and may be affected by the water in Buck Creek.


A "BOIL WATER ADVISORY" was issued by the District of Houston and remains in effect until further notice. As a public health precaution, people using the District of Houston municipal water system are being asked to boil their drinking water and water used for domestic purposes such as washing food or cleaning teeth (particularly for infants, elderly and immune compromised).

Water should be boiled for two (2) minutes, then covered and stored in the fridge OR add two drops of household bleach (chlorine) per litre of water, mix together and wait 30 minutes before drinking. For those concerned about dishwashing, add 1 ml household bleach per litre of water.

Pursuant to Safe Drinking Water Standards, potable water should have a count of less than one total coliform and less than one fecal coliform. The District of Houston municipal water system has had unsatisfactory levels of total coliform and fecal coliform in its water test results.

The solution is to chlorinate the municipal water system, which kills the bacteria. The interim measure to achieve this is to install chlorine dosing pumps for all wells and to do a one time chlorination of the Water Tower to distribute chlorine throughout the water system.

TAKE NOTICE

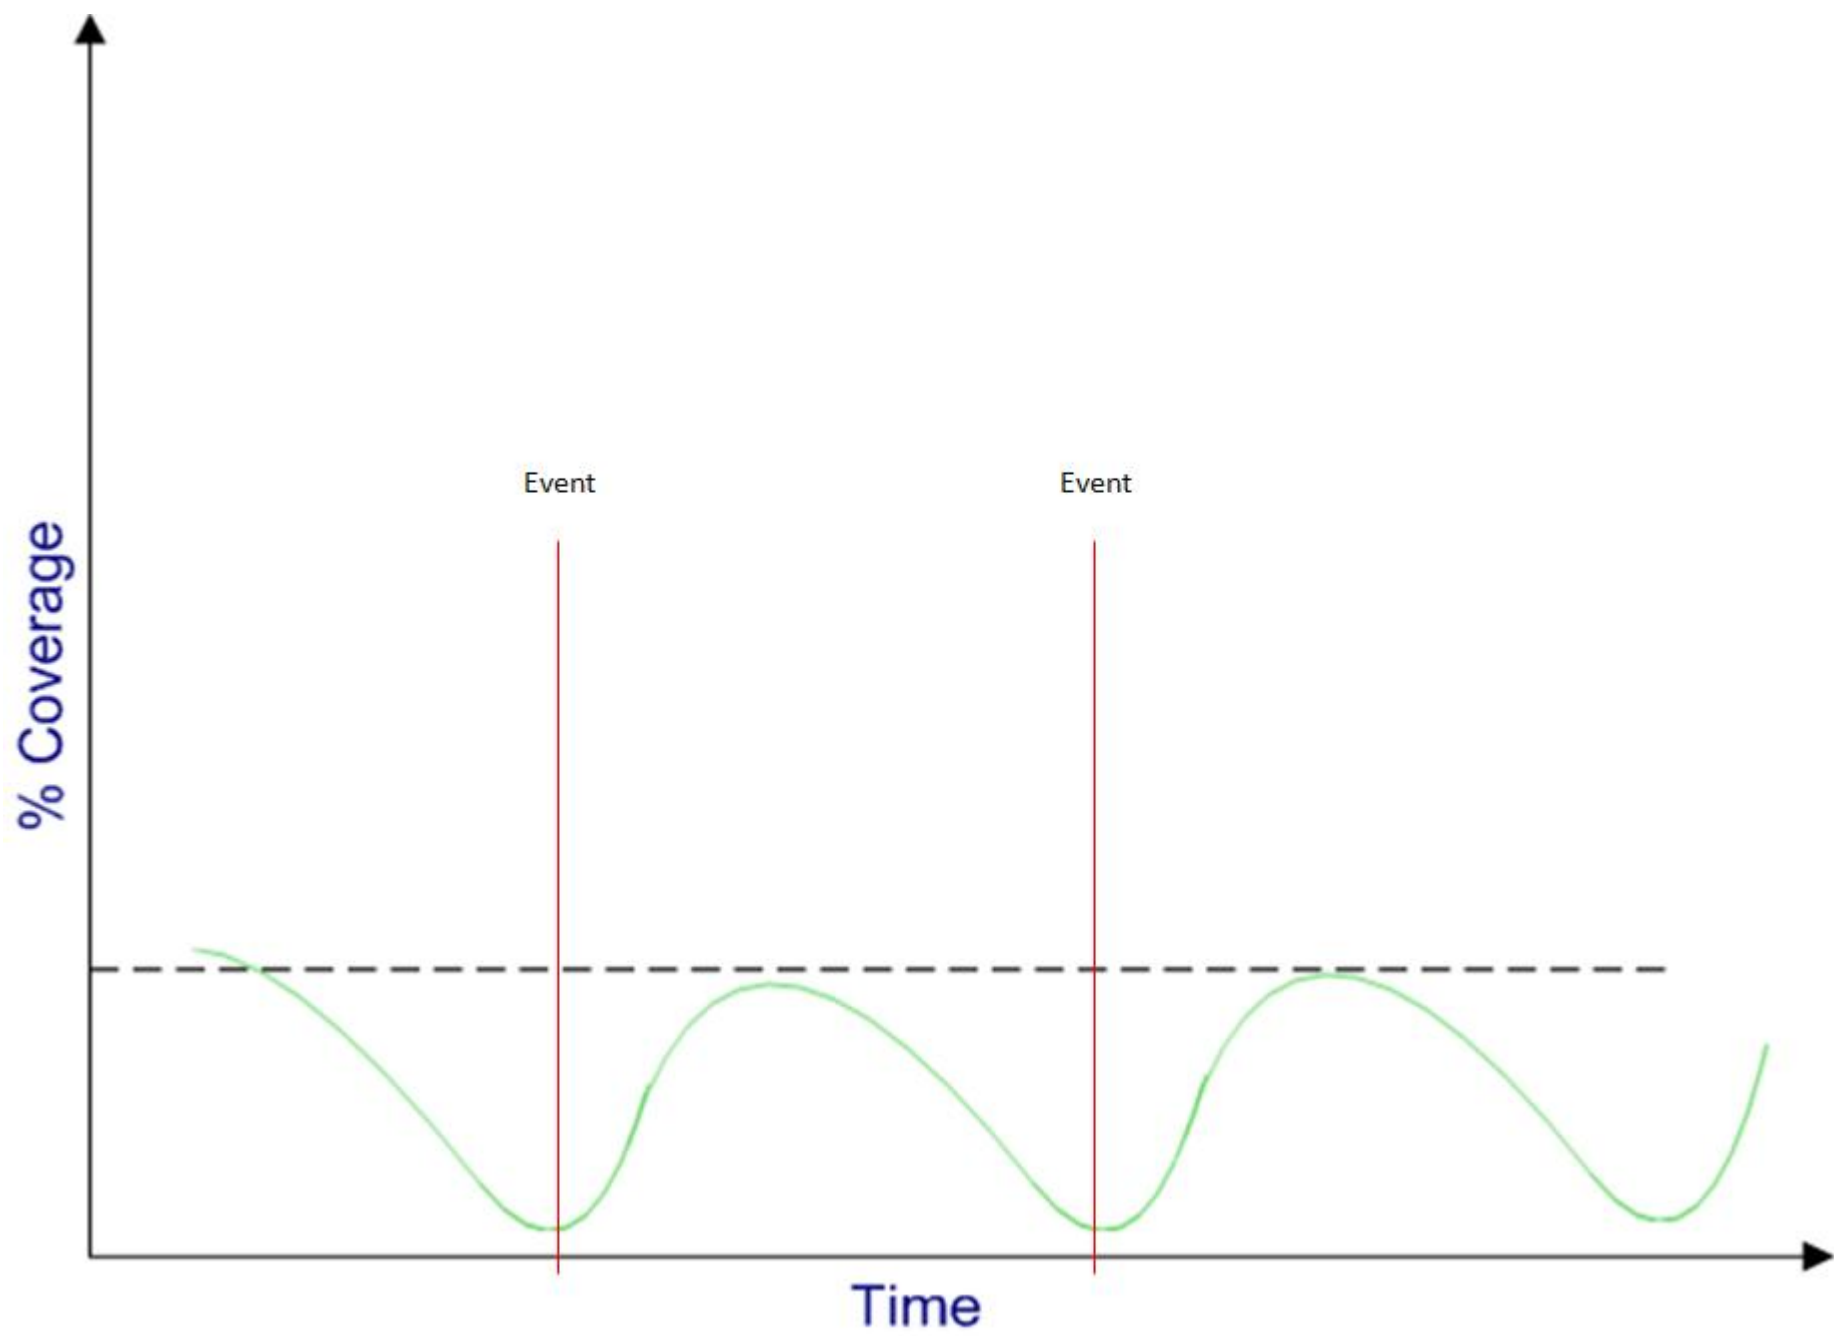



Microsoft
VineTM

david waldrop
david.waldrop@microsoft.com
301.526.9500